



# White Paper

Lightning and surge protection for rooftop photovoltaic systems



## Contents

Cable routing and earthing of PV systems

Separation distance  $s$  as per IEC 62305-3 (EN 62305-3)

Core shadows on solar cells

Special surge protective devices for the d.c. side of PV systems

Type 1 and 2 d.c. arrester for use in PV systems

Selection of SPDs according to the voltage protection level  $U_p$

Building with and without external lightning protection system

HVI Conductors

Module inverters

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems



At present, about one million PV systems are installed in Germany. Based on the fact that self-generated electricity is generally cheaper and provides a high degree of independence of electricity from the grid, PV systems will become an integral part of electrical installations in the future. However, these systems are exposed to all weather conditions and must withstand them over decades.

The cables of PV systems frequently enter the building and extend over long distances until they reach the grid connection point.

Lightning discharges cause field-based and conducted electrical interference. This effect increases in relation with increasing cable lengths or conductor loops. Surges do not only damage the PV modules, inverters and their monitoring electronics, but also devices in the building installation. More importantly, production facilities of industrial buildings may also easily be damaged and production may come to a halt.

If surges are injected into systems that are far from the power grid, which are also referred to as stand-alone PV systems, the operation of equipment powered by solar electricity (e.g. medical equipment, water supply) may be disrupted.

### Necessity of a rooftop lightning protection system

The energy released by a lightning discharge is one of the most frequent causes of fire. Therefore, personal and fire protection is of paramount importance in case of a direct lightning strike to the building.

At the design stage of a PV system, it is evident whether a lightning protection system is installed on a building. Some countries' building regulations require that public buildings (e.g. places of public assembly, schools and hospitals) be equipped with a lightning protection system. In case of industrial or private buildings it depends on their location, type of construction and utilisation whether a lightning protection system must be installed. To this end, it must be determined whether lightning strikes are to be expected or could have severe consequences. Structures in need of protection must be provided with permanently effective lightning protection systems.

According to the state of scientific and technical knowledge, the installation of PV modules does not increase the risk of a lightning strike. Therefore, the request for lightning protection measures cannot be derived directly from the mere existence of a PV system. However, substantial lightning interference may be injected into the building through these systems. Therefore, it is necessary to determine the risk resulting from a lightning strike as per IEC 62305-2 (EN 62305-2) and to take the results from this risk analysis into account when installing the PV system. For this purpose, DEHN offers the DEHNsupport Toolbox software which allows to determine the risk. A risk analysis performed by means of this software provides a re-

sult which is understood by all parties involved. The software compares the risk with the technical expenditure and provides economically optimised protection measures.

Section 4.5 (Risk Management) of Supplement 5 of the German DIN EN 62305-3 standard describes that a lightning protection system designed for class of LPS III (LPL III) meets the usual requirements for PV systems. In addition, adequate lightning protection measures are listed in the German VdS guideline 2010 (Risk-oriented lightning and surge protection) published by the German Insurance Association. This guideline also requires that LPL III and thus a lightning protection system according to class of LPS III be installed for rooftop PV systems (> 10 kW<sub>p</sub>) and that surge protection measures be taken.

**As a general rule, rooftop photovoltaic systems must not interfere with the existing lightning protection measures.**

### Necessity of surge protection for PV systems

In case of a lightning discharge, surges are induced on electrical conductors. Surge protective devices (SPDs) which must be installed upstream of the devices to be protected on the a.c., d.c. and data side have proven very effective in protecting electrical systems from these destructive voltage peaks. Section 9.1 of the CLC/TS 50539-12 standard (Selection and application principles - SPDs connected to photovoltaic installations) calls for the installation of surge protective devices unless a risk analysis demonstrates that SPDs are not required. According to the IEC 60364-4-44 standard, surge protective devices must also be installed for buildings without external lightning protection system such as commercial and industrial buildings, e.g. agricultural facilities. Supplement 5 of the German DIN EN 62305-3 standard provides a detailed description of the types of SPDs and their place of installation.

### Cable routing of PV systems

Cables must be routed in such a way that large conductor loops are avoided. This must be observed when combining the d.c. circuits to form a string and when interconnecting several strings. Moreover, data or sensor lines must not be routed over several strings and form large conductor loops with the string lines. This must also be observed when connecting the inverter to the grid connection. For this reason, the power (d.c. and a.c.) and data lines (e.g. radiation sensor, yield monitoring) must be routed together with the equipotential bonding conductors along their entire route.

### Earthing of PV systems

PV modules are typically fixed on metal mounting systems. The live PV components on the d.c. side feature double or reinforced insulation (comparable to the previous protective

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems

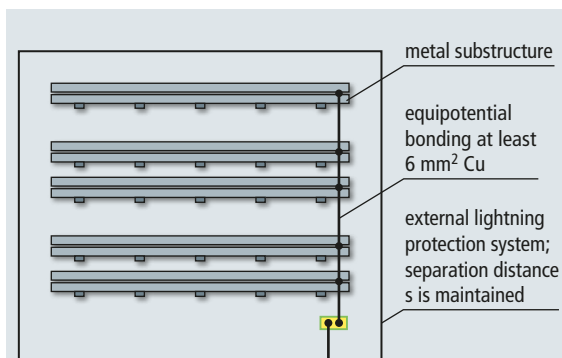


Figure 1 Functional earthing of the mounting rails if no external lightning protection system is installed or the separation distance is maintained (DIN EN 62305-3, Supplement 5)

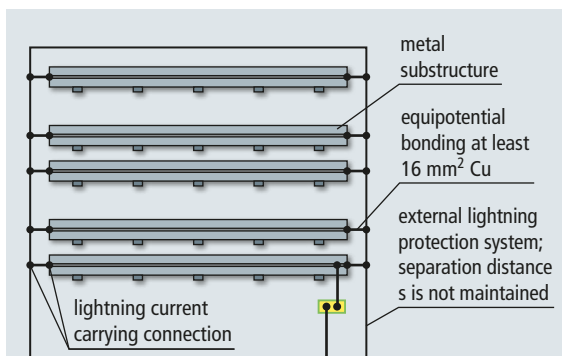


Figure 2 Lightning equipotential bonding for the mounting rails if the separation distance is not maintained



Figure 3 UNI earthing clamp: A stainless steel intermediate element prevents contact corrosion, thus establishing reliable long-term connections between different conductor materials

insulation) as required in the IEC 60364-4-41 standard. The combination of numerous technologies on the module and inverter side (e.g. with or without galvanic isolation) results in different earthing requirements. Moreover, the insulation monitoring system integrated in the inverters is only permanently effective if the mounting system is connected to earth. Information on the practical implementation is provided in Supplement 5 of the German DIN EN 62305-3 standard. The metal substructure is functionally earthed if the PV system is located in the protected volume of the air-termination systems and the separation distance is maintained. Section 7 of Supplement 5 requires copper conductors with a cross-section of at least 6 mm<sup>2</sup> or equivalent for functional earthing (**Figure 1**). The mounting rails also have to be permanently interconnected by means of conductors of this cross-section. If the mounting system is directly connected to the external lightning protection system due to the fact that the separation distance  $s$  cannot be maintained, these conductors become part of the lightning equipotential bonding system. Consequently, these elements must be capable of carrying lightning currents. The minimum requirement for a lightning protection system designed for class of LPS III is a copper conductor with a cross-section of 16 mm<sup>2</sup> or equivalent. Also in this case, the mounting rails must be permanently interconnected by means of conductors of this cross-section (**Figure 2**). The functional earthing/lightning equipotential bonding conductor should be routed in parallel and as close as possible to the d.c. and a.c. cables/lines.

UNI earthing clamps (**Figure 3**) can be fixed on all common mounting systems. They connect, for example, copper conductors with a cross-section of 6 or 16 mm<sup>2</sup> and bare round wires with a diameter from 8 to 10 mm to the mounting frame in such a way that they can carry lightning currents. The integrated stainless steel (V4A) contact plate ensures corrosion protection for the aluminium mounting systems.

### Separation distance $s$ as per IEC 62305-3 (EN 62305-3)

A certain separation distance  $s$  must be maintained between a lightning protection system and a PV system. It defines the distance required to avoid uncontrolled flashover to adjacent metal parts resulting from a lightning strike to the external lightning protection system. In the worst case, such an uncontrolled flashover can set a building on fire. In this case, damage to the PV system becomes irrelevant. Details on the calculation of the separation distance  $s$  can be found in our Lightning Protection Guide and can be easily and quickly calculated by means of the DEHN Distance Tool software.

### Core shadows on solar cells

The distance between the solar generator and the external lightning protection system is absolutely essential to prevent

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems



excessive shading. Diffuse shadows cast by, for example overhead lines, do not significantly affect the PV system and the yield. However, in case of core shadows, a dark clearly outlined shadow is cast on the surface behind an object, changing the current flowing through the PV modules. For this reason, solar cells and the associated bypass diodes must not be influenced by core shadows. This can be achieved by maintaining a sufficient distance. For example, if an air-termination rod with a diameter of 10 mm shades a module, the core shadow is steadily reduced as the distance from the module increases. After 1.08 m only a diffuse shadow is cast on the module (Figure 4). Annex A of Supplement 5 of the German DIN EN 62305-3 standard provides more detailed information on the calculation of core shadows.

### Special surge protective devices for the d.c. side of photovoltaic systems

The UI characteristics of photovoltaic current sources are very different from that of conventional d.c. sources: They have a non-linear characteristic (Figure 5) and cause long-term persistence of ignited arcs. This unique nature of PV current sources does not only require larger PV switches and PV fuses, but also a disconnecter for the surge protective device which is adapted to this unique nature and capable of coping with PV currents. Supplement 5 of the German DIN EN 62305-3 standard (subsection 5.6.1, Table 1) describes the selection of adequate SPDs.

To facilitate the selection of type 1 SPDs, Tables 1 and 2 shown the required lightning impulse current carrying capability  $I_{imp}$  depending on the class of LPS, number of down conductors of the external lightning protection systems as well as the SPD type (voltage-limiting varistor-based arrester or voltage-switching spark-gap-based arrester). SPDs which comply with the applicable EN 50539-11 standard must be used. Subsection 9.2.2.7 of CENELEC CLC/TS 50539-12 also refers to this standard.

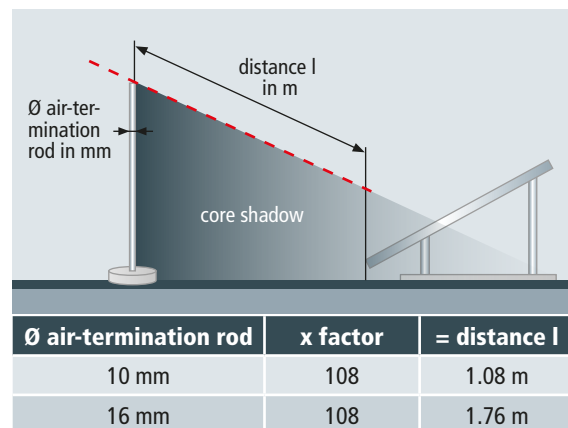


Figure 4 Distance between the module and the air-termination rod required to prevent core shadows

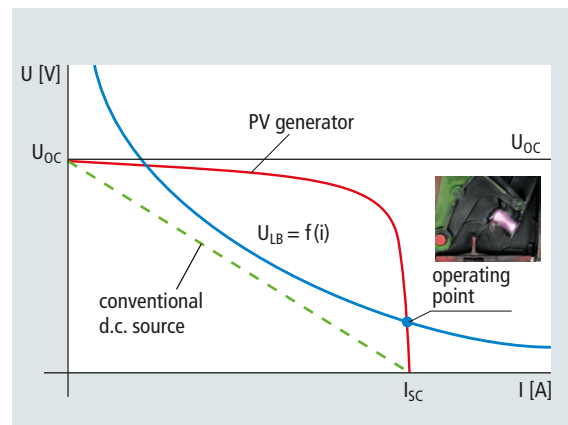


Figure 5 Source characteristic of a conventional d.c. source versus the source characteristic of a PV generator. When switching PV sources, the source characteristic of the PV generator crosses the arc voltage range

Class of LPS and max. lightning current (10/350 µs)		Number of down conductors of the external lightning protection system			
		< 4		≥ 4	
		Values for the voltage-limiting type 1 SPDs or type 1 combined SPDs (series connection) based on a selection of $I_{8/20}$ (8/20 µs) and $I_{10/350}$ (10/350 µs)			
		$I_{SPD1} = I_{SPD2}$ $I_{8/20} / I_{10/350}$	$I_{SPD3} = I_{SPD1} + I_{SPD2} = I_{total}$ $I_{8/20} / I_{10/350}$	$I_{SPD1} = I_{SPD2}$ $I_{8/20} / I_{10/350}$	$I_{SPD3} = I_{SPD1} + I_{SPD2} = I_{total}$ $I_{8/20} / I_{10/350}$
I or unknown	200 kA	17/10	34/20	10/5	20/10
II	150 kA	12.5/7.5	25/15	7.5/3.75	15/7.5
III and IV	100 kA	8.5/5	17/10	5/2.5	10/5

Table 1 Selection of the minimum discharge capacity of voltage-limiting type 1 SPDs (varistors) or type 1 combined SPDs (series connection of varistors and spark gaps); according to CENELEC CLC/TS 50539-12 (Table A.1)

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems



Class of LPS and max. lightning current (10/350 $\mu$ s)		Number of down conductors of the external lightning protection system			
		< 4		$\geq 4$	
		Values for the voltage-switching type 1 SPDs or type 1 combined SPDs (parallel connection)			
		$I_{SPD1} = I_{SPD2}$ $I_{imp}$	$I_{SPD3} = I_{SPD1} + I_{SPD2} = I_{total}$ $I_{imp}$	$I_{SPD1} = I_{SPD2}$ $I_{imp}$	$I_{SPD3} = I_{SPD1} + I_{SPD2} = I_{total}$ $I_{imp}$
I or unknown	200 kA	25	50	12.5	25
II	150 kA	18.5	37.5	9	18
III and IV	100 kA	12.5	25	6.25	12.5

Table 2 Selection of the minimum discharge capacity of voltage switching type 1 SPDs (spark gaps) or type 1 combined arresters (parallel connection of varistors and spark gaps); according to CENELEC CLC/TS 50539-12 (Table A.2)



Figure 6 DEHNcombo YPV SCI type 1 combined arrester for protecting photovoltaic systems from surges and partial lightning currents

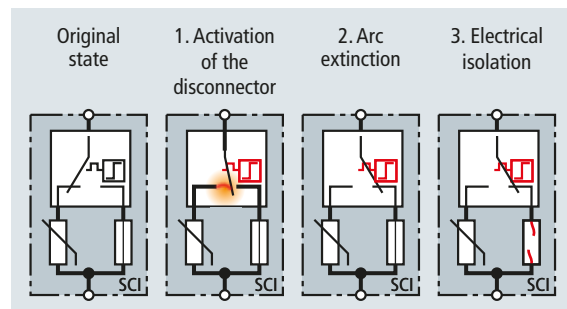


Figure 7 Switching phases of the three-step d.c. switching device integrated in DEHNguard M YPV SCI ... (FM)

### Type 1 d.c. arrester for use in PV systems: Multipole type 1 + type 2 combined d.c. arrester, DEHNcombo YPV SCI (FM)

With their integrated SCI technology, DEHNcombo YPV SCI (FM) combined arresters (Figure 6) fulfil the above mentioned requirements. In addition to the proven fault-resistant Y circuit, DEHNcombo YPV SCI (FM) features a three-step d.c. switching device (SCI technology). This d.c. switching device consists of a combined disconnection and short-circuiting device with Thermo Dynamic Control and a fuse in the bypass path. This circuit (Figure 7) safely disconnects the arrester from the generator voltage in case of an overload and reliably extinguishes d.c. arcs. Thus, DEHNcombo YPV SCI (FM) allows to protect PV generators up to 1000 A without additional backup fuse. This arrester combines a lightning current arrester and a surge arrester in a single device, thus ensuring efficient protection of terminal equipment. With its discharge capacity  $I_{total}$  of 12.5 kA (10/350  $\mu$ s), it can be flexibly used for the highest classes of LPS. DEHNcombo YPV SCI (FM)

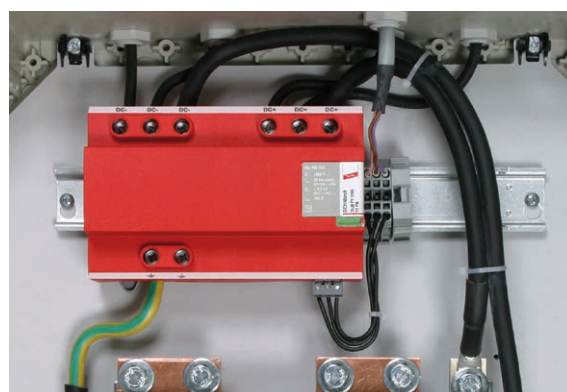


Figure 8 DEHNlimit PV 1000 V2 spark-gap-based type 1 combined arrester

is available for voltages  $U_{CPV}$  of 600 V, 1000 V and 1500 V and has a width of only 4 modules. Therefore, DEHNcombo YPV SCI (FM) is the ideal type 1 combined arrester for use in photovoltaic power supply systems.

Voltage-switching spark-gap-based type 1 SPDs, for example DEHNlimit PV 1000 V2 (Figure 8), are another powerful

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems

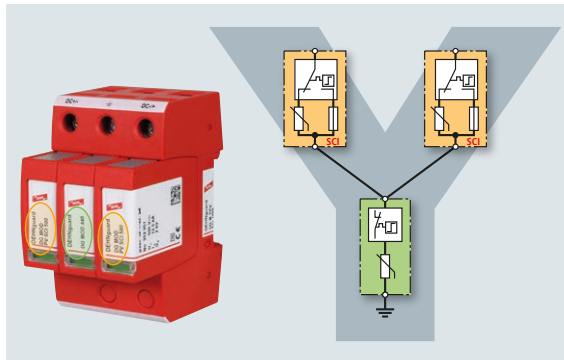


Figure 9 Modular DEHNGuard M YPV SCI ... (FM) type 2 surge arrester with fault-resistant Y circuit and three-step d.c. switching device



Figure 10 Ready-to-install type 2 surge arrester DEHNCube YPV SCI 1000 1M

technology that allows to discharge partial lightning currents in case of d.c. PV systems. Thanks to its spark gap technology and a d.c. extinction circuit which allow to efficiently protect downstream electronic systems, this arrester series has an extremely high lightning current discharge capacity  $I_{total}$  of 50 kA (10/350  $\mu$ s) which is unique on the market.

### Type 2 d.c. arrester for use in PV systems: DEHNGuard M YPV SCI ... (FM) and DEHNCube YPV SCI ...

Reliable operation of SPDs in d.c. PV circuits is also indispensable when using type 2 surge protective devices. To this end, the DEHNGuard M YPV SCI ... (FM) and DEHNCube YPV SCI ... surge arresters also feature a fault-resistant Y protective circuit and the SCI technology (Figure 9) and are also connected to PV generators up to 1000 A without additional backup fuse.



Figure 11 DEHNGuard type 2 SPD integrated in the inverter for the a.c. and d.c. side


The numerous technologies combined in these arresters prevent damage to surge protective devices due to insulation faults in the PV circuit, the risk of fire of an overloaded arrester and puts the arrester in a safe electrical state without disrupting the operation of the PV system. Thanks to the protective circuit, the voltage-limiting characteristic of varistors can be fully used even in the d.c. circuits of PV systems and numerous small voltage peaks are minimised. Thus, the SCI technology increases the service life of the entire d.c.-side PV system.

### Selection of SPDs according to the voltage protection level $U_p$

The operating voltage on the d.c. side of PV systems differs from system to system. At present, values up to 1500 V d.c. are possible. Consequently, the dielectric strength of terminal equipment also differs. To ensure that the PV system is reliably protected, the voltage protection level  $U_p$  of the SPD must be lower than the dielectric strength of the PV system it is supposed to protect. The CLC/TS 50539-12 standard requires that  $U_p$  is at least 20% lower than the dielectric strength of the PV system. Type 1 or type 2 SPDs must be energy-coordinated with the input of terminal equipment. If SPDs are already integrated in terminal equipment, coordination between the type 2 SPD and the input circuit of terminal equipment is ensured by the manufacturer (Figure 11).

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems

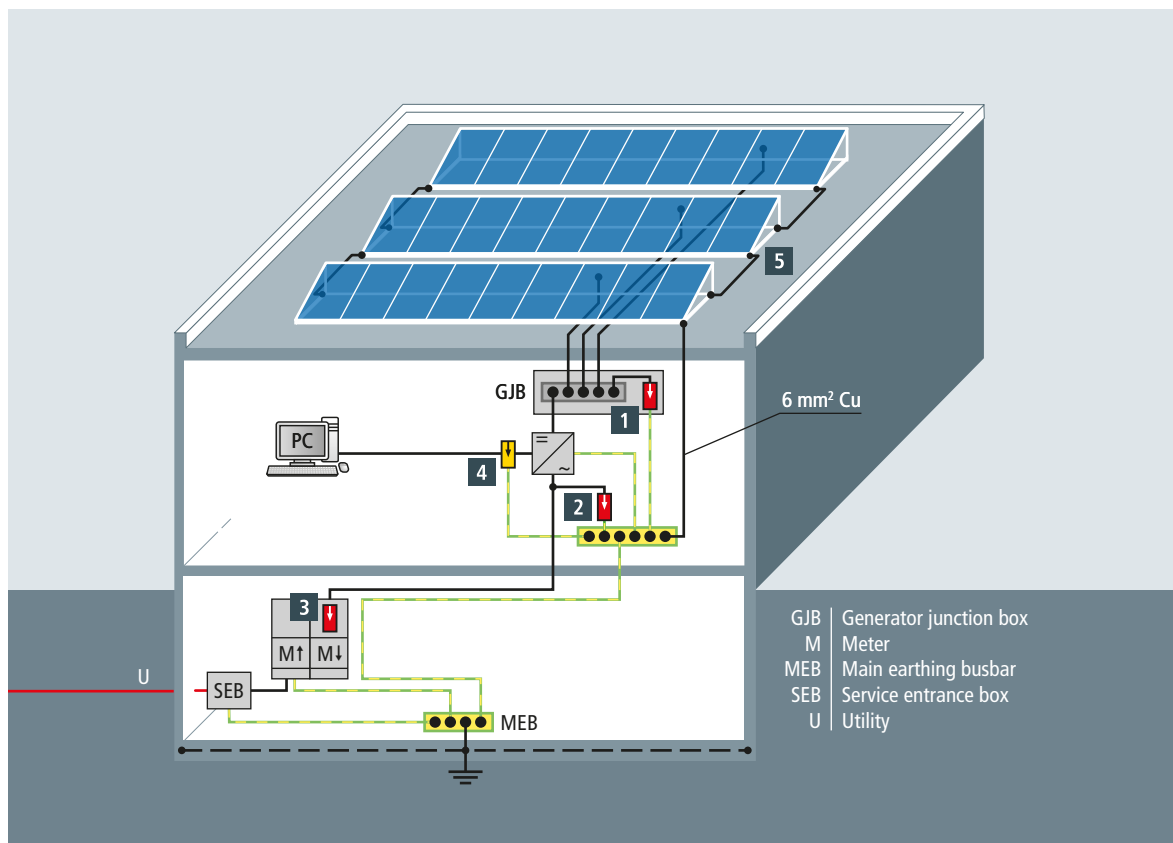


No. in Fig.		SPD	*FM = Floating remote signalling contact	Part No.
<b>d.c. input of the inverter</b>				
1	Per MPPT	DEHNguard DG M YPV SCI 1000 FM*		952 515
	For 1 MPPT	DEHNcube DCU YPV SCI 1000 1M		900 910
	For 2 MPPTs	DEHNcube DCU YPV SCI 1000 2M		900 920
<b>a.c. output of the inverter</b>				
2	TN-S system	DEHNguard DG M TNS 275 FM*		952 405
<b>Low-voltage input</b>				
3	TN-C system	DEHNguard DG M TNC CI 275 FM*		952 309
	TN-S system	DEHNguard DG M TNS CI 275 FM*		952 406
	TT system	DEHNguard DG M TT CI 275 FM*		952 327
<b>Data interface</b>				
4	Two pairs, even with different operating voltages up to 180 V	BLITZDUCTOR BXTU ML4 BD 0-180 + BXT BAS base part		920 349 + 920 300
<b>Functional earthing</b>				
5	Functional equipotential bonding	UNI earthing clamp		540 250

Figure 12 Building without external protection system – situation A (Supplement 5 of the DIN EN 62305-3 standard)

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems

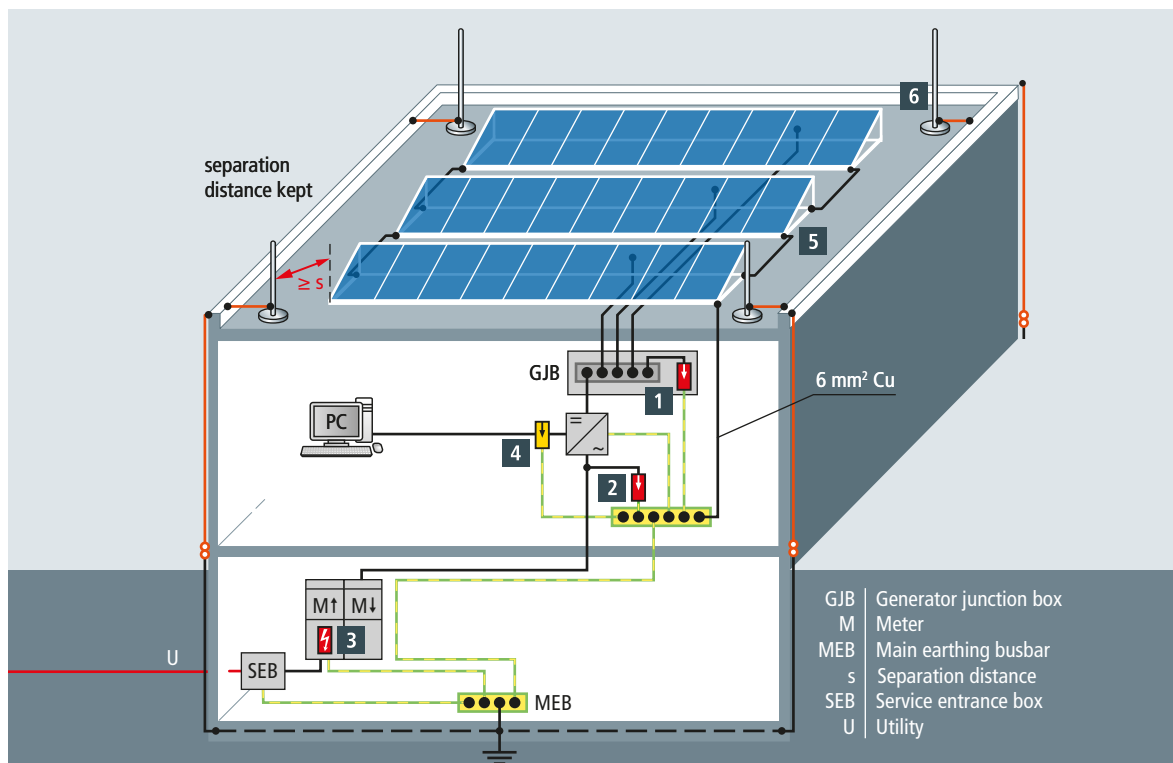

GJB Generator junction box  
 M Meter  
 MEB Main earthing busbar  
 s Separation distance  
 SEB Service entrance box  
 U Utility

No. in Fig.		SPD	*FM = Floating remote signalling contact	Part No.
<b>d.c. input of the inverter</b>				
1	Per MPPT	DEHNguard DG M YPV SCI 1000 FM*		952 515
	For 1 MPPT	DEHNcube DCU YPV SCI 1000 1M		900 910
	For 2 MPPTs	DEHNcube DCU YPV SCI 1000 2M		900 920
<b>a.c. output of the inverter</b>				
2	TN-S system	DEHNguard DG M TNS 275 FM*		952 405
<b>Low-voltage input</b>				
3	TN-C system	DEHNventil DV M TNC 255 FM*		951 305
	TN-S system	DEHNventil DV M TNS 255 FM*		951 405
	TT system	DEHNventil DV M TT 255 FM*		951 315
<b>Data interface</b>				
4	Two pairs, even with different operating voltages up to 180 V	BLITZDUCTOR BXTU ML4 BD 0-180 + BXT BAS base part		920 349 + 920 300
<b>Functional earthing / External lightning protection system</b>				
5	Functional equipotential bonding	UNI earthing clamp		540 250
6	PV modules	Air-termination rod with concrete base (8.5 kg)		101 000
				+ 102 075

Figure 13 Building with external protection system and sufficient separation distance – situation B (Supplement 5 of the DIN EN 62305-3 standard)



# White Paper

## Lightning and surge protection for rooftop photovoltaic systems



Figure 14 Determination of the protected volume using the protective angle method

### Application examples:

#### Building without external lightning protection system (situation A)

Figure 12 shows the surge protection concept for a PV system installed on a building without external lightning protection system. Dangerous surges enter the PV system due to inductive coupling resulting from nearby lightning strikes or travel from the power supply system through the service entrance to the consumer's installation. Type 2 SPDs are to be installed at the following locations:

- ➔ d.c.-side of the modules and inverters
- ➔ a.c. output of the inverter
- ➔ Main low-voltage distribution board
- ➔ Wired communication interfaces

Every d.c. input (MPP) of the inverter must be protected by a type 2 surge protective device, for example DEHNgard M YPV SCI ... (FM), that reliably protects the d.c. side of PV systems. The CENELEC CLC/TS 50539-12 standard requires

that an additional type 2 d.c. arrester be installed on the module side if the distance between the inverter input and the PV generator exceeds 10 m.

The a.c. outputs of the inverters are sufficiently protected if the distance between the PV inverters and the place of installation of the type 2 arrester at the grid connection point (low-voltage infeed) is less than 10 m. In case of greater cable lengths, an additional type 2 surge protective device, for example DEHNgard M ... 275, must be installed upstream of the a.c. input of the inverter as per CLS/TS 50539-12.

Moreover, a type 2 DEHNgard M ... CI 275 (FM) surge protective device must be installed downstream of the meter of the low-voltage infeed. CI (Circuit Interruption) stands for a coordinated fuse integrated in the protective path of the arrester, allowing the arrester to be used in the a.c. circuit without additional backup fuse. DEHNgard M ... CI 275 (FM) is available for every low-voltage system configuration (TN-C, TN-S, TT).

If inverters are connected to data and sensor lines to monitor the yield, suitable surge protective devices are required. BLITZDUCTOR XTU, which features terminals for two pairs, for example for incoming and outgoing data lines, can be used for data systems based on RS 485.

#### Building with external lightning protection system and sufficient separation distance $s$ (situation B)

Figure 13 shows the surge protection concept for a PV system with external lightning protection system and sufficient separation distance  $s$  between the PV system and the external lightning protection system.

The primary protection goal is to avoid damage to persons and property (building fire) resulting from a lightning strike. In this context, it is important that the PV system does not interfere with the external lightning protection system. Moreover, the PV system itself must be protected from direct lightning strikes. This means that the PV system must be installed in the protected volume of the external lightning protection system. This protected volume is formed by air-termination systems (e.g. air-termination rods) which prevent direct lightning strikes to the PV modules and cables. The protective angle method (Figure 14) or rolling sphere method (Figure 15) as described in subsection 5.2.2 of the IEC 62305-3 (EN 62305-3) standard may be used to determine this protected volume. A certain separation distance  $s$  must be maintained between all conductive parts of the PV system and the lightning protection system. In this context, core shad-

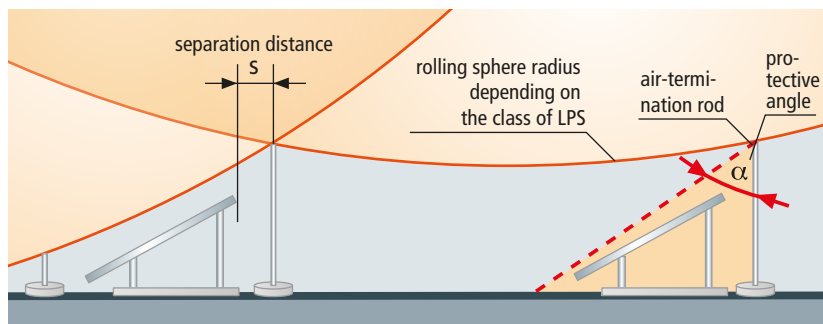


Figure 15 Rolling sphere method versus protective angle method for determining the protected volume

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems



Figure 16 DEHNcube YPV SCI 1000 1M type 2 arrester for protecting inverters (1 MPPT)

ows must be prevented by, for example, maintaining a sufficient distance between the air-termination rods and the PV module.

Lightning equipotential bonding is an integral part of a lightning protection system. It must be implemented for all conductive systems and lines entering the building which may carry lightning currents. This is achieved by directly connecting all metal systems and indirectly connecting all energised systems via type 1 lightning current arresters to the earth-termination system. Lightning equipotential bonding should be implemented as close as possible to the entrance point into the building to prevent partial lightning currents from entering the building. The grid connection point must be protected by a multipole spark-gap-based type 1 SPD, for example a type 1 DEHNventil M ... 255 combined arrester. This arrester combines a lightning current arrester and a surge arrester in a single device. If the cable lengths between the arrester and the inverter are less than 10 m, sufficient protection is provided. In case of greater cable lengths, additional type 2 DEHNguard M surge protective devices must be installed upstream of the a.c. input of the inverters as per CENELEC CLC/TS 50539–12.

Every d.c. input of the inverter must be protected by a type 2 PV arrester, for example DEHNcube YPV SCI ... (Figure 16). This also applies to transformerless devices. If the inverters are connected to data lines, for example to monitor the yield, surge protective devices must be installed to protect data transmission. For this purpose, BLITZDUCTOR XTU with actiVsense technology can be provided for lines with analogue signal and data bus systems such as RS485. It au-

tomatically detects the operating voltage of the useful signal and adjusts the voltage protection level to this operating voltage.

### High-voltage-resistant, insulated HVI Conductor

Another possibility to maintain the separation distance  $s$  is to use high-voltage-resistant, insulated HVI Conductors which allow to maintain a separation distance  $s$  up to 0.9 m in air. HVI Conductors may directly contact the PV system downstream of the sealing end range. More detailed information on the application and installation of HVI Conductors is provided in our Lightning Protection Guide or in the relevant installation instructions.

### Building with external lightning protection system with insufficient separation distance $s$ (situation C)

If the roofing is made of metal or is formed by the PV system itself, the separation distance  $s$  cannot be maintained. The metal components of the PV mounting system must be connected to the external lightning protection system in such a way that they can carry lightning currents (copper conductor with a cross-section of at least 16 mm<sup>2</sup> or equivalent). This means that lightning equipotential bonding must also be implemented for the PV lines entering the building from the outside (Figure 17). According to Supplement 5 of the German DIN EN 62305-3 standard and the CLC/TS 50539–12 standard, d.c. lines must be protected by a type 1 SPD for PV systems.

For this purpose, a type 1 and type 2 DEHNcomboYPV SCI (FM) combined arrester is used. Lightning equipotential bonding must also be implemented in the low-voltage infeed. If the PV inverter(s) is (are) situated more than 10 m from the type 1 SPD installed at the grid connection point, an additional type 1 SPD must be installed on the a.c. side of the inverter(s) (e.g. type 1 + type 2 DEHNshield ... 255 combined arrester). Suitable surge protective devices must also be installed to protect the relevant data lines for yield monitoring. BLITZDUCTOR XTU surge protective devices are used to protect data systems, for example based on RS 485.

### PV systems with microinverters

Microinverters require a different surge protection concept. To this end, the d.c. line of a module or a pair of modules is directly connected to the small-sized inverter. In this process, unnecessary conductor loops must be avoided. Inductive coupling into such small d.c. structures typically only has a low energetic destruction potential. The extensive cabling of a PV system with microinverters is located on the a.c. side (Figure 18). If the microinverter is directly fitted at the module, surge protective devices may only be installed on the a.c. side:



# White Paper

## Lightning and surge protection for rooftop photovoltaic systems

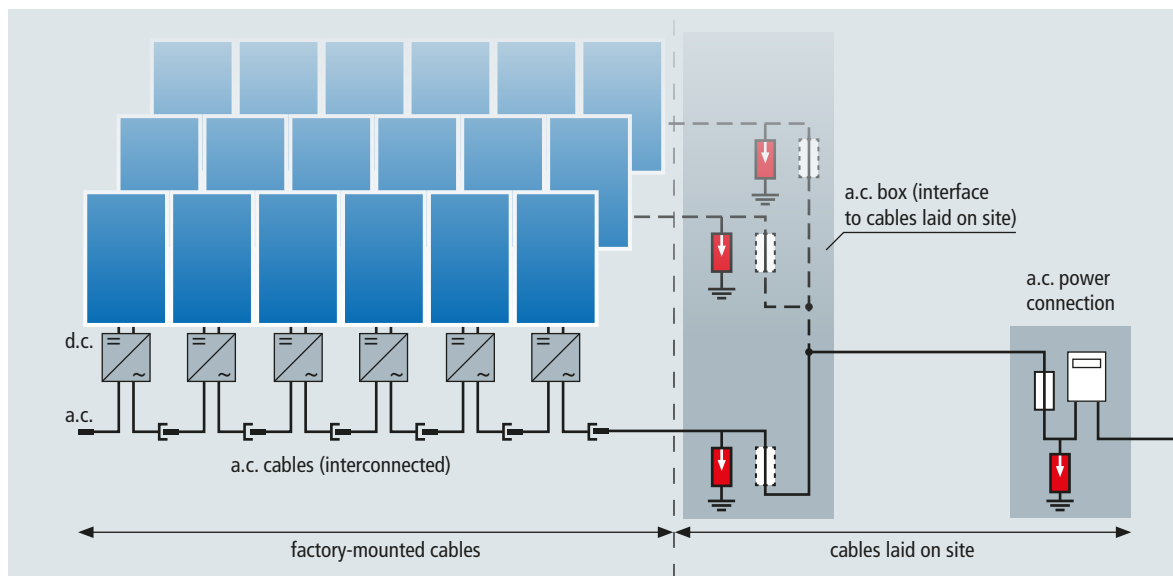


Figure 18 Example: Building without external lightning protection system; surge protection for a microinverter located in the connection box of the on-site cables

- ➔ Buildings without external lightning protection system = type 2 DEHNguard M ... 275 arresters for alternating / three-phase current in close proximity to the microinverters and DEHNguard ... 275 CI at the low-voltage infeed.
- ➔ Buildings with external lightning protection system and sufficient separation distance  $s$  = type 2 arresters, for example DEHNguard M ... 275, in close proximity to the microinverters and lightning current carrying type 1 arresters at the low-voltage infeed, for example DEHNventil M ... 255.
- ➔ Buildings with external lightning protection system and insufficient separation distance  $s$  = type 1 arresters, for example DEHNshield ... 255, in close proximity to the microinverters and lightning current carrying type 1 DEHNventil M ... 255 arresters at the low-voltage infeed.

Independent of particular manufacturers, microinverters feature data monitoring systems. If data is modulated to the a.c. lines via the microinverters, a surge protective device (for example DEHNbox DBX KT BD) must be provided on the separate receiving units (data export / data processing). The same applies to interface connections with downstream bus systems and their voltage supply (e.g. Ethernet, ISDN).




Solar power generation systems are an integral part of today's electrical systems. They should be equipped with adequate lightning current and surge arresters, thus ensuring long-term faultless operation of these sources of electricity.

# White Paper

Lightning and surge protection for rooftop photovoltaic systems



## Products and technical data

d.c. side		
<b>DEHNcombo</b>		
	Type	DCB YPV SCI 1000 FM
	Part No.	900 066
	SPD acc. to EN 50539-11	Type 1 + Type 2
	Max. PV voltage [DC+ → DC-] / [DC+/DC → PE] ( $U_{CPV}$ )	$\leq 1000 \text{ V} / \leq 720 \text{ V}$
	Short-circuit current rating ( $I_{SCPV}$ )	1000 A
	Nominal discharge current (8/20 $\mu\text{s}$ ) ( $I_n$ )	15 kA
	Total discharge current (10/350 $\mu\text{s}$ ) [DC+/ DC → PE] ( $I_{total}$ ) / [DC+ → PE/DC → PE] ( $I_{imp}$ )	12.5 kA / 6.25 kA
	Voltage protection level [(DC+/DC-) → PE] / [DC+ → DC-] ( $U_p$ )	2.5 kV / 4.75 kV
<b>DEHNlimit</b>		
	Type	DLM PV 1000 V2 FM
	Part No.	900 345
	SPD acc. to EN 61643-11 / IEC 61643-11	Type 1 / Class I
	Max. cont. operating voltage (d.c.) ( $U_{max DC}$ )	1000 V
	Min. cont. operating voltage (d.c.) ( $U_{min DC}$ )	100 V
	Follow current extinguishing capability (d.c.) ( $I_{fi DC}$ )	100 A
	Nominal discharge current (8/20 $\mu\text{s}$ ) ( $I_n$ )	25 kA
	Lightning impulse current (10/350 $\mu\text{s}$ ) [DC+/DC- → PE] / [DC+ → DC-] ( $I_{imp}$ )	50 kA / 25 kA
	Voltage protection level [DC+ → DC-] / [(DC+/DC-) → PE] ( $U_p$ )	$\leq 3.3 \text{ kV} / \leq 4 \text{ kV}$
<b>DEHNguard</b>		
	Type	DG M YPV SCI 1000 FM
	Part No.	952 515
	SPD acc. to EN 50539-11	Type 2
	Maximum PV voltage ( $U_{CPV}$ )	$\leq 1000 \text{ V}$
	Short-circuit current rating ( $I_{SCPV}$ )	1000 A
	Nominal discharge current (8/20 $\mu\text{s}$ ) [(DC+/DC-) → PE] ( $I_n$ )	12.5 kA
	Voltage protection level ( $U_p$ )	$\leq 4 \text{ kV}$
	Voltage protection level at 5 kA ( $U_p$ )	$\leq 3.5 \text{ kV}$

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems



### DEHNCube



Type	DCU YPV SCI 1000 1M
Part No.	900 910
SPD acc. to EN 50539-11	Type 2
Maximum PV voltage ( $U_{CPV}$ )	$\leq 1000$ V
Short-circuit current rating ( $I_{SCPV}$ )	1000 A
Total discharge current (8/20 $\mu$ s) [(DC+/DC-) $\rightarrow$ PE] ( $I_{total}$ )	40 kA
Nominal discharge current (8/20 $\mu$ s) ( $I_n$ )	12.5 kA
Nominal discharge current (8/20 $\mu$ s) [(DC+/DC-) $\rightarrow$ PE] ( $I_{max}$ )	25 kA
Voltage protection level ( $U_p$ )	$\leq 4$ kV
Voltage protection level at 5 kA ( $U_p$ )	$\leq 3.5$ kV
Degree of protection	IP 65



Type	DCU YPV SCI 1000 2M
Part No.	900 920
SPD acc. to EN 50539-11	Type 2
Maximum PV voltage ( $U_{CPV}$ )	$\leq 1000$ V
Short-circuit current rating ( $I_{SCPV}$ )	1000 A
Total discharge current (8/20 $\mu$ s) [(DC+/DC-) $\rightarrow$ PE] ( $I_{total}$ )	40 kA
Nominal discharge current (8/20 $\mu$ s) ( $I_n$ )	12.5 kA
Max. discharge current (8/20 $\mu$ s) [(DC+/DC-) $\rightarrow$ PE] ( $I_{max}$ )	25 kA
Voltage protection level ( $U_p$ )	$\leq 4$ kV
Voltage protection level at 5 kA ( $U_p$ )	$\leq 3.5$ kV
Degree of protection	IP 65

### Connecting cable for DEHNCube




Type	AL DCU X PV L600	AL DCU X PV L1000
	Part No.	900 946
For connecting	2 strings	
Cross-sectional area	6 mm <sup>2</sup>	
Degree of protection	IP 65	
Length (1) [ $\rightarrow$ inverter]	600 mm	1000 mm
Length (2) [ $\rightarrow$ DEHNCube]	300 mm	
Length (3) [ $\rightarrow$ +/- string]	100 mm	
Length (4) [ $\rightarrow$ +/- string]	200 mm	

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems






### Connecting cable for DEHncube

	Type	AL DCU Y PV L600	AL DCU X PV L1000
	Part No.	900 948	900 949
	For connecting	1 string	
	Cross-sectional area	6 mm <sup>2</sup>	
	Degree of protection	IP 65	
	Length (1) [→ inverter]	600 mm	1000 mm
	Length (2) [→ DEHncube]	300 mm	
	Length (3) [→ +/- string]	100 mm	

### a.c. side (inverter)

#### DEHNventil

	Type	DV M TNC 255 FM
	Part No.	951 305
	SPD acc. to EN 61643-11 / IEC 61643-11	Type 1 + Type 2 / Class I + Class II
	Max. continuous operating voltage (a.c.) (U <sub>C</sub> )	264 V
	Lightning impulse current (10/350 μs) [L1+L2+L3-PEN] (I <sub>total</sub> ) / [L-PEN] (I <sub>imp</sub> )	75 kA / 25 kA
	Nominal discharge current (8/20 μs) (I <sub>n</sub> )	25 / 75 kA
	Voltage protection level (U <sub>p</sub> )	≤ 1.5 kV
	Type	DV M TNS 255 FM
	Part No.	951 405
	SPD acc. to EN 61643-11 / IEC 61643-11	Type 1 + Type 2 / Class I + Class II
	Max. continuous operating voltage (a.c.) (U <sub>C</sub> )	264 V
	Lightning impulse current (10/350 μs) [L1+L2+L3+N-PE] (I <sub>total</sub> ) / [L, N-PE] (I <sub>imp</sub> )	100 kA / 25 kA
	Nominal discharge current (8/20 μs) (I <sub>n</sub> )	25 / 100 kA
	Voltage protection level (U <sub>p</sub> )	≤ 1.5 kV / ≤ 1.5 kV
	Type	DV M TT 255 FM
	Part No.	951 315
	SPD acc. to EN 61643-11 / IEC 61643-11	Type 1 + Type 2 / Class I + Class II
	Max. continuous operating voltage (a.c.) (U <sub>C</sub> )	264 V
	Lightning impulse current (10/350 μs) [L1+L2+L3+N-PE] (I <sub>total</sub> ) /	100 kA
	Lightning impulse current (10/350 μs) [L-N] / [N-PE] (I <sub>imp</sub> )	25 / 100 kA
	Nominal discharge current (8/20 μs) (I <sub>n</sub> )	25 / 100 kA
Voltage protection level [L-N] / [N-PE] (U <sub>p</sub> )	≤ 1.5 kV / ≤ 1.5 kV	

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems



### DEHNshield



Type	DSH TNS 255
Part No.	941 400
SPD acc. to EN 61643-11 / IEC 61643-11	Type 1 + Type 2 / Class I + Class II
Max. continuous operating voltage (a.c.) ( $U_C$ )	255 V
Lightning impulse current (10/350 $\mu$ s) [L1+L2+L3+N-PE] ( $I_{total}$ )	50 kA
Lightning impulse current (10/350 $\mu$ s) [L, N-PE] ( $I_{imp}$ )	12.5 kA
Nominal discharge current (8/20 $\mu$ s) ( $I_n$ )	12.5/50 kA
Voltage protection level [L-PE] / [N-PE] ( $U_p$ )	$\leq 1.5 / \leq 1.5$ kV

### DEHNGuard ... CI



Type	DG M TNC CI 275 FM
Part No.	952 309
SPD acc. to EN 61643-11 / IEC 61643-11	Type 2 / Class II
Max. continuous operating voltage (a.c.) ( $U_C$ )	275 V
Nominal discharge current (8/20 $\mu$ s) ( $I_n$ )	12.5 kA
Voltage protection level ( $U_p$ )	$\leq 1.5$ kV
Voltage protection level at 5 kA ( $U_p$ )	$\leq 1$ kV



Type	DG M TNS CI 275 FM
Part No.	952 406
SPD acc. to EN 61643-11 / IEC 61643-11	Type 2 / Class II
Max. continuous operating voltage (a.c.) ( $U_C$ )	275 V
Nominal discharge current (8/20 $\mu$ s) ( $I_n$ )	12.5 kA
Voltage protection level ( $U_p$ )	$\leq 1.5$ kV
Voltage protection level at 5 kA ( $U_p$ )	$\leq 1$ kV



Typ	DG M TT CI 275 FM
Part No.	952 327
SPD acc. to EN 61643-11 / IEC 61643-11	Type 2 / Class II
Max. continuous operating voltage (a.c.) [L-N] / [N-PE] ( $U_C$ )	275 V / 255 V
Nominal discharge current (8/20 $\mu$ s) [L-N] / [N-PE] ( $I_n$ )	12.5 kA / 20 kA
Lightning impulse current (10/350 $\mu$ s) [N-PE] ( $I_{imp}$ )	12 kA
Voltage protection level [L-N] / [N-PE] ( $U_p$ )	$\leq 1.5$ kV / $\leq 1.5$ kV
Voltage protection level [L-N] at 5 kA ( $U_p$ )	$\leq 1$ kV



# White Paper

## Lightning and surge protection for rooftop photovoltaic systems



### DEHNguard



Type	DG M TNS 275 FM
Part No.	952 405
SPD acc. to EN 61643-11 / IEC 61643-11	Type 2 / Class II
Max. continuous operating voltage (a.c.) ( $U_C$ )	275 V
Nominal discharge current (8/20 $\mu$ s) ( $I_n$ )	20 kA
Voltage protection level ( $U_p$ )	$\leq 1.5$ kV
Voltage protection level at 5 kA ( $U_p$ )	$\leq 1$ kV

### Data interface

#### BLITZDUCTOR XTU



Type	BXTU ML4 BD 0-180
Part No.	920 349
SPD class/SPD monitoring	<b>TYPE 1 P1</b> / LifeCheck
Operating voltage ( $U_N$ )	0-180 V
Max. continuous operating voltage (d.c./a.c.) ( $U_C$ )	180 V / 127 V
D1 Lightning impulse current (10/350 $\mu$ s) total / per line ( $I_{imp}$ )	10 / 2.5 kA
C2 Nominal discharge current (8/20 $\mu$ s) total / per line ( $I_n$ )	20 kA / 10 kA
Voltage protection level line-line for $I_{imp}$ D1 ( $U_p$ )	$\leq U_N + 53$ V
Voltage protection level line-PG for C2/C3/D1	$\leq 550$ V
Test standards	IEC 61643-21 / EN 61643-21, UL 497B

#### BLITZDUCTOR XT



Type	BXT BAS
Part No.	920 300
For mounting on	35 mm DIN rails acc. to EN 60715
Cross-sectional area (solid / flexible)	0.08–4 mm <sup>2</sup> / 0.08–2.5 mm <sup>2</sup>
Earthing via	35 mm DIN rails acc. to EN 60715

# White Paper

## Lightning and surge protection for rooftop photovoltaic systems



### DEHNbox



Type	DBX TC 180
Part No.	922 210
SPD class	<b>TYPE 1 P2</b>
Nominal voltage ( $U_N$ )	180 V
Max. continuous operating voltage (d.c.) ( $U_C$ )	180 V
D1 Lightning impulse current (10/350 $\mu$ s) total/per line ( $I_{imp}$ )	5 kA/2.5 kA
C2 Nominal discharge current (8/20 $\mu$ s) total/per line ( $I_n$ )	15 kA/7.5 kA
Voltage protection level line-line for $I_{imp}$ D1 ( $U_p$ )	$\leq 300$ V
Voltage protection level line-PG for D1/C2/C3	$\leq 550$ V
Test standards	IEC 61643-21 / EN 61643-21

### Functional earthing / external lightning protection

#### UNI earthing clamp



Part No.	540 250
Material of the clamp/screw/nut	StSt
Clamping range $R_d$	8 - 10 mm
Connection (solid/stranded)	4 - 50 mm <sup>2</sup>
Screw	hammer head bolt M8 x 30 mm
Lock nut	wrench size 13 mm
Standard	EN 50164-1

#### Air-termination rod



Part No.	101 000
Total length ( $l_1$ )	1000 mm
Diameter	10 mm
Material	Al
Standard	EN 50164-2

#### Concrete base



Part No.	102 075
Type	stackable
Weight	8.5 kg
Support	wedge $\varnothing$ 10/16 mm
Diameter	240 mm
Material of the base/wedge	concrete (C45/55) / StSt





**Surge Protection  
Lightning Protection  
Safety Equipment  
DEHN protects.**

DEHN + SÖHNE  
GmbH + Co.KG.

Hans-Dehn-Str. 1  
Postfach 1640  
92306 Neumarkt  
Germany

Tel. +49 9181 906-0  
Fax +49 9181 906-1100  
info@dehn.de  
[www.dehn-international.com](http://www.dehn-international.com)



[www.dehn-international.com/partners](http://www.dehn-international.com/partners)

Type designations of products mentioned in the white paper being at the same time registered trademarks are not especially marked. So if there is no marking of <sup>TM</sup> or <sup>®</sup> this does not mean that the type designation is a free trade name. Neither it can be seen whether patents or utility models and other intellectual and industrial property rights are available. We reserve the right to introduce changes in performance, configuration and technology, dimensions, weights and materials in the course of technical progress. The figures are shown without obligation. Misprints, errors and modifications excepted. Reproduction in any form whatsoever is forbidden without our authorisation.

actiVsense, BLITZDUCTOR, BLITZPLANER, DEHN, DEHN Logo, DEHN schützt, DEHNbloc, DEHNfix, DEHNgrip, DEHNguard, DEHNport, DEHNQUICK, DEHNrapid, DEHNshield, DEHNSnap, DEHNventil, HVI, LifeCheck, Red/Line are protected by German Trade Mark, by Community Trade Mark (EU) and/or in other countries.